


Notes:

1. Bond all concentric neutrals together.
2. Provide sufficient primary neutral pigtail and cable slack to permit ready disconnection of elbow and mounting on parking stand.

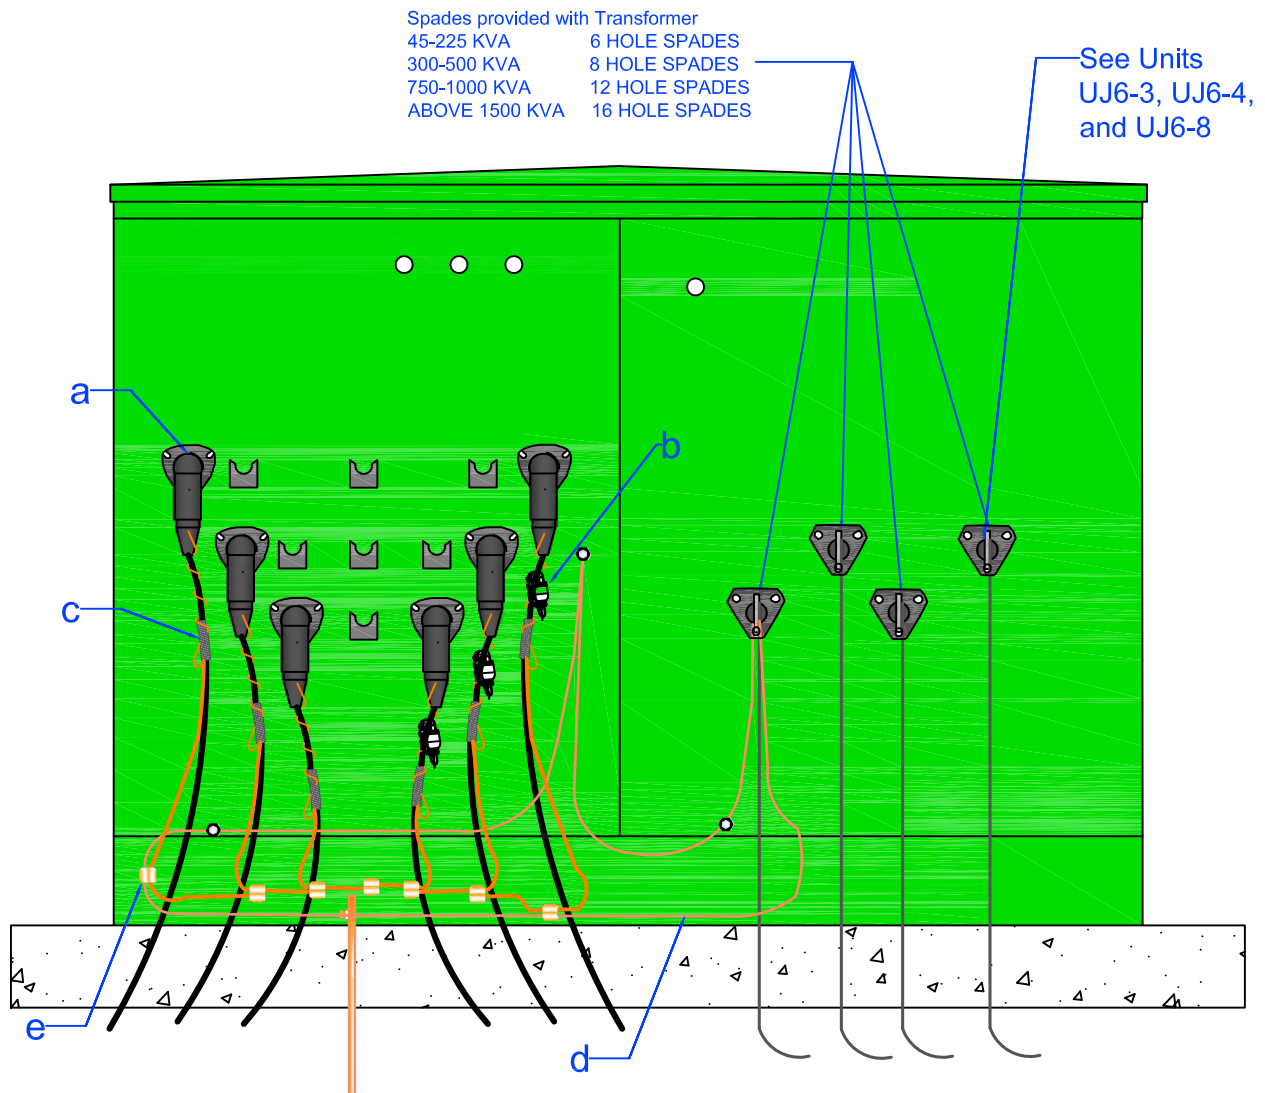

Item	Compatible Unit	Quantity	Compatible Unit or Material Description
a	VUM3-1	6	25KV Primary Cable Terminal
b	UM6-4	3	Indicator Fault 1Ph 200 Manual Reset
c	N/A	*6	2000558 - Kit Cable Sealing 1/0
d	N/A	As Req'd	2001293 - Wire Copper Bare #2 7 Str
e	N/A	As Req'd	Connector

* Denotes "Grab bag" items.



URD CONSTRUCTION
 SPECIFICATIONS

3Ø Padmount Transformer
 Feed Thru

drawn: JBS	approved MJB	date: July 17, 2013
---------------	-----------------	------------------------

103-002-0713