


Notes:

1. Bond all concentric neutrals together.
2. Provide sufficient primary neutral pigtail and cable slack to permit ready disconnection of elbow and mounting on parking stand.

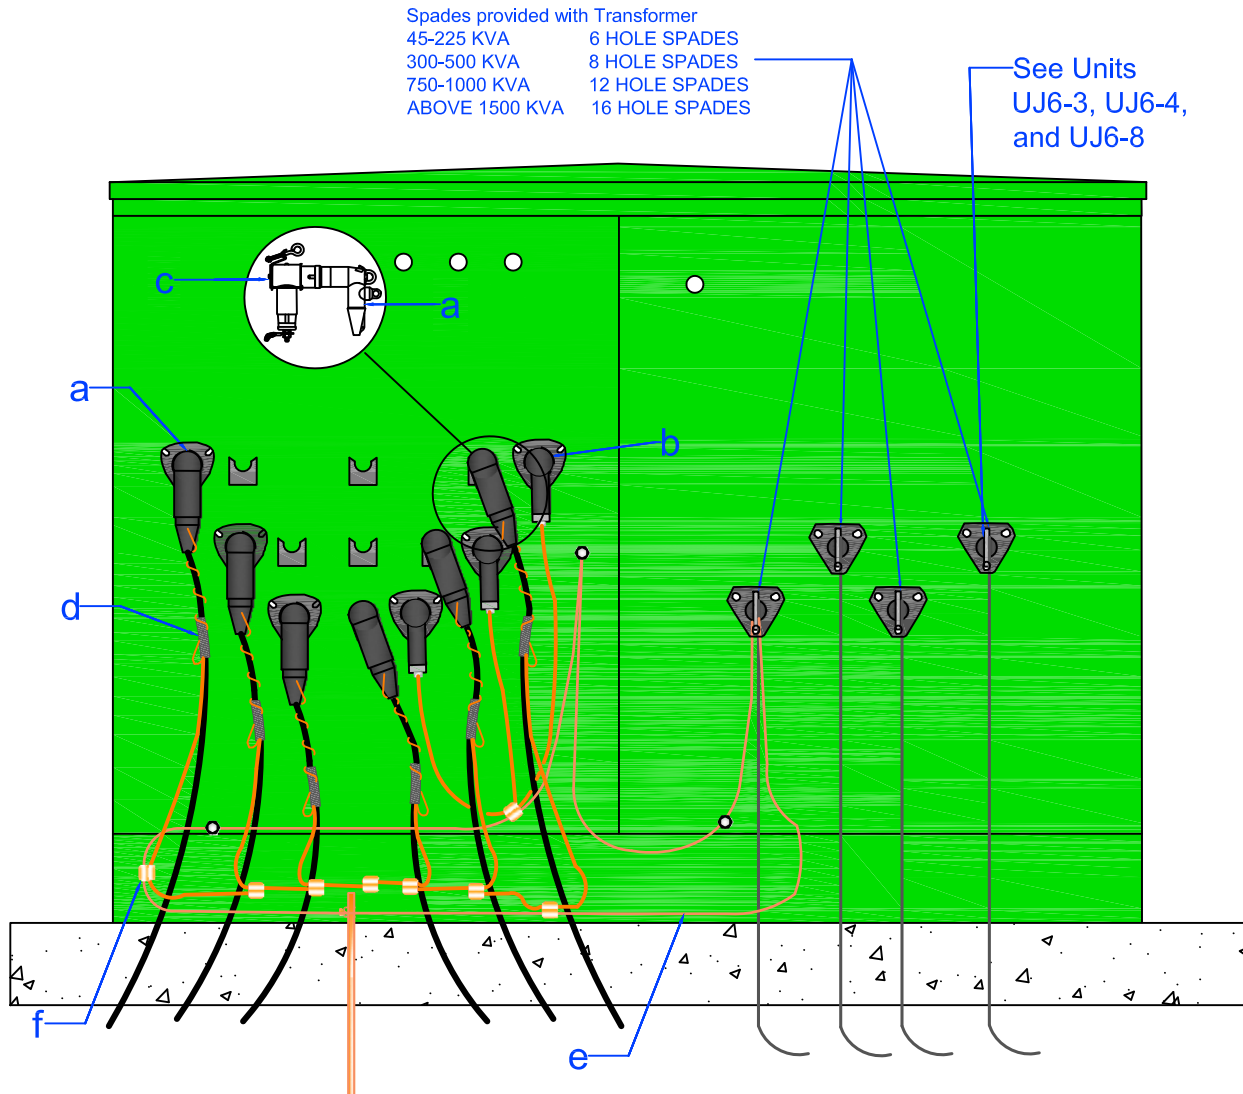

Item	Compatible Unit	Quantity	Compatible Unit or Material Description
a	VUM3-1	6	25KV Primary Cable Terminal
b	VUM5-9	3	Arrester Elbow 18KV URD
c	VUM5-10	3	Arrester Parking Stand Type 18KV
d	N/A	*6	2000558 - Kit Cable Sealing 1/0
e	N/A	As Req'd	2001293 - Wire Copper Bare #2 7 Str
f	N/A	As Req'd	Connectors

* Denotes "Grab bag" items.



URD CONSTRUCTION SPECIFICATIONS

3Ø Padmount Transformer Two Way Feed

drawn: JBS	approved MJB	date: July 17, 2013	103-003-0713
---------------	-----------------	------------------------	--------------