


Notes:

1. Bond all concentric neutrals together.
2. Provide sufficient primary neutral pigtail and cable slack to permit ready disconnection of elbow and mounting on parking stand.

Tray ground should be independently connected to case ground, not the equipment lug.

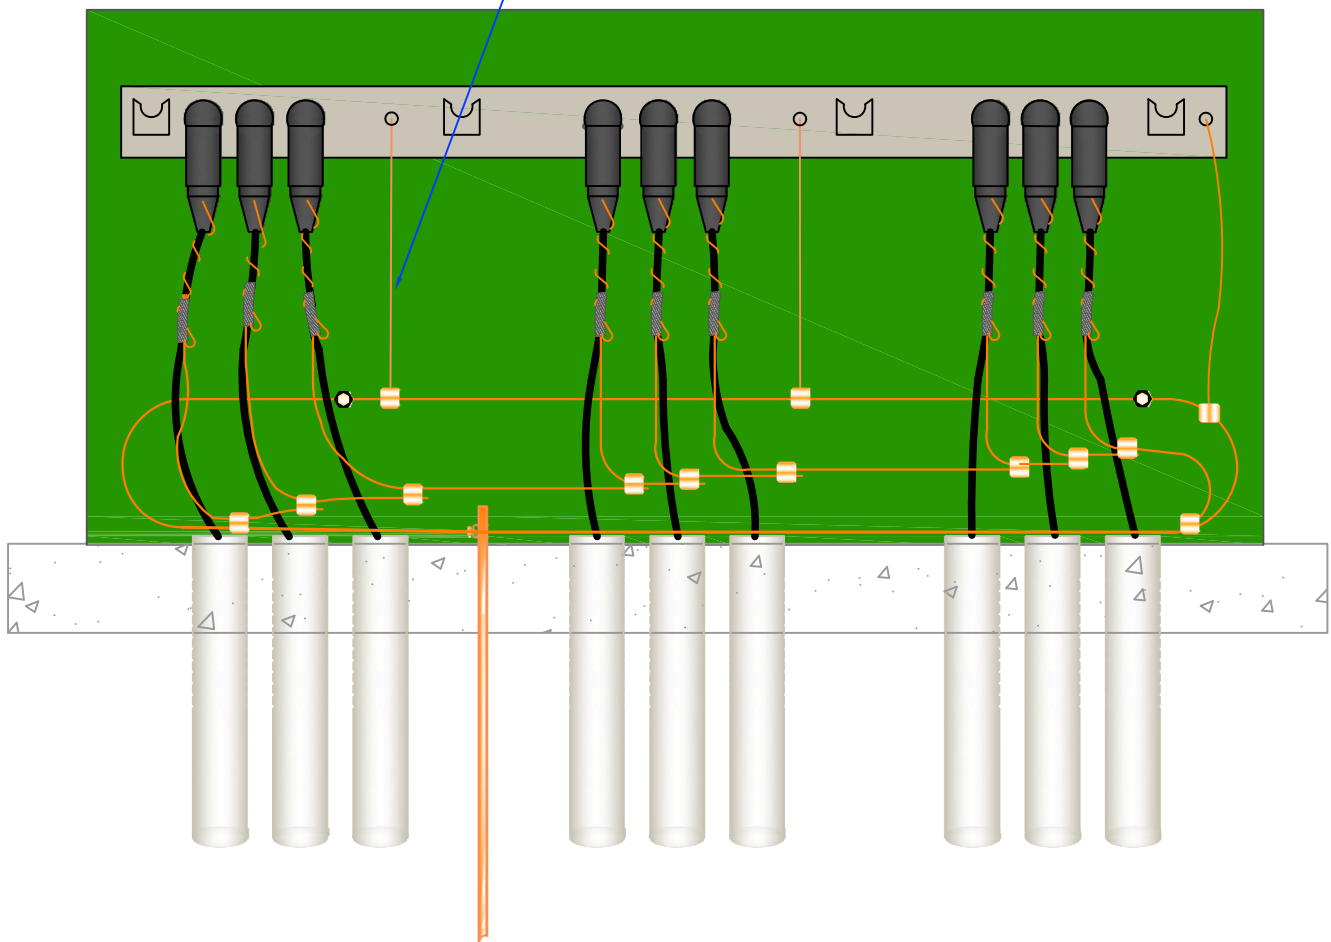

URD CONSTRUCTION SPECIFICATIONS

Primary Enclosure Grounds

drawn:	approved	date:	201-001-0713
JBS	MJB	July 18, 2013	